



Attachments:

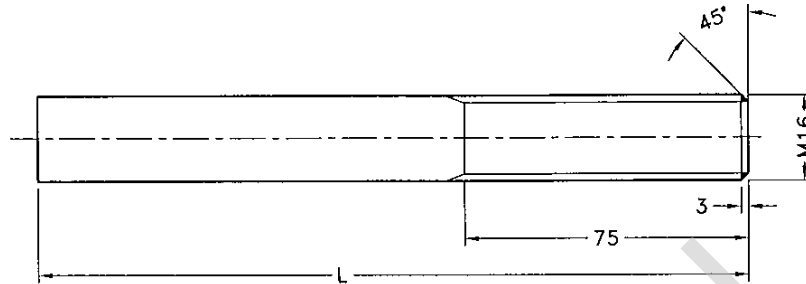

No.	PD	L	Weight(kg)
1	130.....144	98	0.155
2	145.....159	113	0.178
3	160.....174	128	0.2
4	175.....189	143	0.225
5	190.....204	158	0.25
6	205.....219	173	0.273
7	PD>= 220	PD-40	


25...50 kVA

Uncertain tolerances according to DIN ISO 2768-m

1	1	Bolt	Ust.37k	M16xL	
	-	DIN 668	DIN 671		
Qt.	Item No.	Description	Material	Dimension	Mass. Kg
	Index	Identity No.	Standard		
Index	Mod.No.	Date	Modifications	Signature	Title:
					Hanger Bolt
					Ordered by:
Tolerance:	Group:	Applied by:	Drawing Identification:		
Scale: --		Gozi	I T R I - - R 1 1		
		Asadi	Drawing No.:		
		Approved by:	N D 0 E 0 3 - 0 1 0 -		
 شرکت ترانسفورماتور توزیع زنجان ZANGAN DISTRIBUTION TRANSFORMER CO.		Date:	Page.Count No.:	Page No.:	
		1397/07/10		1+	

Attachments:

Substituted of: G.Z-043/2

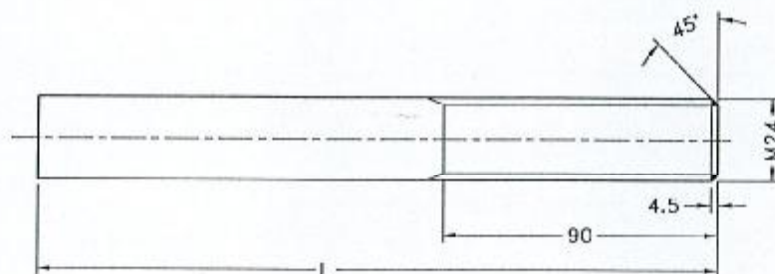

No.	PD	L	Weight(kg)
1	125.....134	94	0.333
2	135.....144	104	0.37
3	145.....154	114	0.4
4	155.....164	124	0.44
5	165.....174	134	0.475
6	175.....184	144	0.511
7	185.....194	154	0.546
8	195.....204	164	0.582
9	205.....214	174	0.61
10	215.....224	184	0.653
11	225.....234	194	0.685
12	235.....244	204	0.724
13	245.....254	214	0.76
14	255.....264	224	0.795
15	265.....274	234	0.83
16	275.....284	244	0.866
17	285.....294	254	0.9
18	295.....304	264	0.94

100...315 kVA

Uncertain tolerances according to DIN ISO 2768-m


1	1	Bolt	Ust.37k	M24xL	
	-	DIN 668	DIN 671		
Qt.	Item No.	Description	Material	Dimension	Mass. Kg
	Index	Identity No.	Standard		
Index	Mod.No.	Date	Modifications	Signature	Title:
					Hanger Bolt
					Ordered by:
Tolerance:	Group:	Applied by:	Drawing Identification:		
Scale: ---		Fajr	I T R I - - R 1 1		
		Check by:	Drawing No.:		
		Asadi	N D 0 E 0 3 - 0 1 0 -		
		Approved by:	Date:	Page Count No.:	Page No.:
			1389/08/03		2+



شرکت توزیع ایران ترانسفو زنگان
TOZIE IRAN TRANSFO ZANGAN CO.

Attachments:

Substituted of: G.Z-043/3

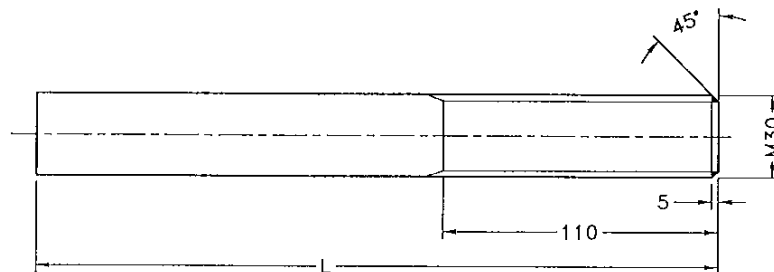

No.	PD	L	Weight(kg)
1	169.....178	150	0.83
2	179.....188	160	0.88
3	189.....198	170	0.94
4	199.....208	180	0.1
5	209.....218	190	1.05
6	219.....228	200	1.11
7	229.....238	210	1.16
8	239.....248	220	1.22
9	249.....258	230	1.27
10	259.....268	240	1.33
11	269.....278	250	1.38
12	279.....288	260	1.44
13	289.....298	270	1.5
14	299.....308	280	1.55
15	309.....318	290	1.6
16	319.....328	300	1.66
17	329.....338	310	1.72
18	339.....348	320	1.77
19	349.....358	330	1.83
20	359.....368	340	1.88
21	369.....378	350	1.94


400...630 kVA

Uncertain tolerances according to DIN ISO 2768-m

1	1	Bolt	Ust.37k	M30xL	
	—	DIN 668	DIN 671		
Qt.	Item No.	Description	Material	Dimension	Mass.
	Index	Identity No.	Standard		Kg
Index	Mod.No.	Date	Modifications	Signature	Title:
					Hanger Bolt
					Ordered by:
Tolerance:	Group:	Applied by:	Drawing Identification:		
Scale: —		<i>Fogi</i>	I T R I — — R 1 1		
		Check by:	Drawing No.:		
		<i>Asadi</i>	N D O E 0 3 - 0 1 0		
		Approved by:	Date:	Page.Count No.:	Page No.:
			1389/08/03		3+



شرکت توزیع ایران ترانسفورماتورها
TOZIE IRAN TRANSFO ZANGAN CO.

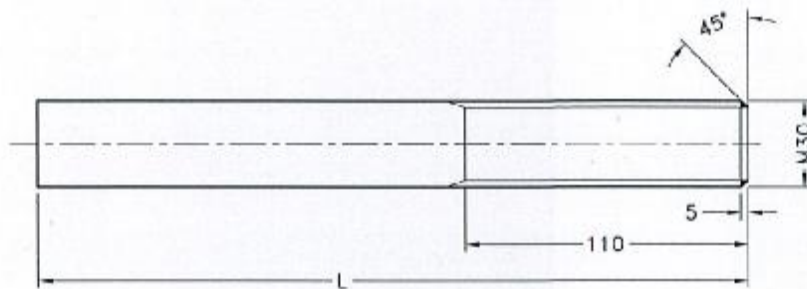

No.	PD	L	Weight(kg)
0	245.....259	235	1.30
1	260.....269	240	1.33
2	270.....279	250	1.38
3	280.....289	260	1.44
4	290.....299	270	1.5
5	300.....309	280	1.55
6	310.....319	290	1.6
7	320.....329	300	1.66
8	330.....339	310	1.72
9	340.....349	320	1.77
10	350.....359	330	1.83
11	360.....369	340	1.88
12	370.....379	350	1.94
13	380.....389	360	2
14	390.....399	370	2.05
15	400.....409	380	2.1
16	410.....419	390	2.16
17	420.....429	400	2.218
18	430.....439	410	2.27
19	440.....449	420	2.33
20	450.....459	430	2.38
21	460.....469	440	2.44
22	470.....479	450	2.49
23	480.....489	460	2.55

No.	PD	L	Weight(kg)
24	490.....499	470	2.6
25	500.....509	480	2.66
26	510.....519	490	2.72
27	520.....529	500	2.77
28	530.....539	510	2.828
29	540.....549	520	2.88
30	550.....559	530	2.94
31	560.....569	540	2.99
32	570.....579	550	3.05
33	580.....589	560	3.1
34	590.....599	570	3.16
35	600.....609	580	3.216
36	610.....619	590	3.27
37	620.....629	600	3.33

>=800 kVA

Uncertain tolerances according to DIN ISO 2768-m

1	1	Bolt	Ust.37k	M30xL	
		DIN 668	DIN 671		
Qt.	Item No.	Description	Material	Dimension	Mass. Kg
	Index	Identity No.	Standard		
Index	Mod.No.	Date	Modifications	Signature	Title:
					Hanger Bolt
					Ordered by:
Tolerance:	Group:	Applied by:	Drawing Identification:		
Scale: --		Fori	I T R I - - R 1 1		
		Check by:	Drawing No.:		
		Asadi	N D O E 0 3 - 0 1 0 -		
		Approved by:	Date:	Page Count No.:	Page No.:
			1393/09/26		4-



شرکت ترانسفورماتور توزیع زنگان
ZANGAN DISTRIBUTION TRANSFORMER CO.